

2020 REPORT



CITY & COUNTY OF BROOMFIELD

2020 ANNUAL DRINKING WATER QUALITY REPORT



WATER AND YOUR FAMILY'S HEALTH

Drinking Water and Health

In order to ensure that tap water is safe to drink, the Colorado Department of Public Health and Environment prescribes regulations limiting the amount of certain contaminants in water provided by public water systems. The Food and Drug Administration regulations establish limits for contaminants in bottled water that must provide the same protection for public health.



Drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. The presence of contaminants does not necessarily indicate the water poses a health risk. More information about contaminants and potential health effects can be obtained by calling the **EPA Safe Drinking Water Hotline (800-426-4791)**.

Special Health Concerns

Some people may be more vulnerable to contaminants in drinking water than the general population. Immuno-compromised persons such as persons with cancer undergoing chemotherapy, persons who have undergone organ transplants, people with HIV/AIDS or other immune system disorders, some elderly, and infants can be particularly at risk from infections. These people should seek advice about drinking water from their health care providers. EPA/CDC guidelines on appropriate means to lessen the risk of infection by Cryptosporidium and other microbial contaminants are available from the **Safe Drinking Water Hotline (800-426-4791)**.

Lead in Drinking Water and Its Effects on Children

If present, elevated levels of lead can cause serious health problems, especially for pregnant women and young children. Lead in drinking water is primarily from materials and components associated with service lines and home plumbing. The City and County of Broomfield is responsible for providing high quality drinking water, but cannot control the variety of materials used in plumbing components. When your water has been sitting for several hours, you can minimize the potential for lead exposure by flushing your tap for 30 seconds to 2 minutes before using water for drinking or cooking. If you are concerned about lead in your water, you may wish to have your water tested. Information on lead in drinking water, testing methods, and steps you can take to minimize exposure is available from the **Safe Drinking Water Hotline** or at <http://www.epa.gov/safewater/lead>.

Public Water Supply ID# C00107155

The City and County of Broomfield is again pleased to provide you with our Annual Water Quality Report, summarizing water quality data collected from January 1 to December 31, 2020.

The Colorado Department of Public Health and Environment requires all public water systems to inform consumers about their water sources, water treatment processes, and levels of regulated contaminants in drinking water distributed to consumers during the past calendar year. Much more information about Broomfield's drinking water may be obtained by visiting the Environmental Services page of Broomfield's web site (www.broomfield.org) or by calling Laura Hubbard at **303-464-5606**. Broomfield's water supply, treatment, and delivery professionals are committed to providing you with drinking water that is safe, pleasing and dependable.

You're Invited ...

We welcome your input on any water quality or service issue. Broomfield City Council provides opportunities for public input and regularly meets on the 2nd and 4th Tuesdays of each month at 6:00 pm at the City and County Building, One DesCombes Drive. Meetings may be watched live on Channel 8. Notice of upcoming agendas is published on our website at www.broomfield.org, and is posted at the City and County Building.

En Español

Este informe contiene información muy importante acerca de su agua potable. Haga que alguien lo traduzca para usted, o hable con alguien que lo entienda.




BROOMFIELD'S WATER SOURCES

Broomfield is fortunate to have two sources of high-quality drinking water – water treated at our Water Treatment Plant, and treated water purchased from Denver Water. The two sources are allowed to mix in the distribution system. All of Broomfield's drinking water, whether supplied by Broomfield or Denver Water, comes from surface water sources such as rivers, lakes, and reservoirs.

Denver Water may deliver treated water to its municipal customers from any of its three treatment facilities. Water supplying these facilities comes from Denver Water's extensive Moffat and South Platte River collection systems.

The water supply for Broomfield's treatment facility originates in the Colorado and Fraser Rivers west of the Continental Divide, and is delivered through the Northern Colorado Water Conservancy District's Colorado-Big Thompson (CBT) Project. On the eastern slope, Broomfield's water is stored in Carter Lake near Berthoud. From there, it is transported to Broomfield's Water Treatment Plant via a 33-mile pipeline, and stored in Matthew D. Glasser Reservoir, a small storage reservoir adjacent to the treatment facility.

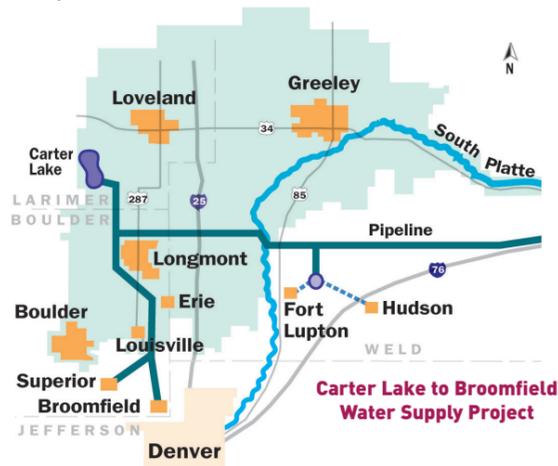

Drinking Water Treatment Process

In 2020, Broomfield's Water Treatment Plant was updated and expanded to a capacity of 26 million gallons of water per day. Chemicals specially formulated for drinking water treatment are added to the raw water to remove particles, microorganisms and other contaminants. Water is then filtered to remove any remaining particles, and disinfected with chloramines to inactivate bacteria and viruses and prevent harmful organisms from growing in the distribution system. Fluoride is added to help prevent tooth decay, and sodium carbonate is added for corrosion control. Certified Water Treatment Operators monitor the treatment process continuously to ensure consistent quality and safety.

Source Water Protection

The best place to prevent or minimize contaminants is at the source! The State of Colorado has developed a Source Water Assessment & Protection (SWAP) program to provide information and encourage community-based source water protection and preventive management strategies to keep our water resources safe from future contamination. You may obtain a copy of the report by visiting www.colorado.gov and searching on 'source water assessment,' or by contacting Laura Hubbard at **303-464-5606**.

The Source Water Assessment Report provides a screening-level evaluation of potential contamination that **could** occur. It does not mean that the contamination **has or will** occur. We can use this information to evaluate the need to improve our current water treatment capabilities and prepare for future contamination threats. This can help us ensure that quality finished water is delivered to your home. In addition, the source water assessment results provide a starting point for developing a source water protection plan.

Potential sources of contamination in our watershed are:

- EPA areas of concern such as solid waste sites
- permitted wastewater discharge sites, septic systems
- above ground, underground or leaking storage tank sites
- existing or abandoned mine sites
- quarries, strip mines and gravel pits
- oil and gas wells, roads
- other commercial/industrial facilities
- commercial, industrial and transportation activities
- residential or urban
- recreational grassy areas
- agricultural and forested areas.

Water Conservation

In addition to protecting our source water, we can all increase our efforts to use water more wisely. To preserve this limited resource, **Broomfield is asking its customers to closely follow**

the watering guidelines developed in cooperation with other Front Range communities. The guidelines are available on the Water Resources web page at www.Broomfield.org. These guidelines offer a common sense approach to using water as efficiently as possible. Efforts to use water efficiently now may postpone or eliminate the need for watering restrictions if the water storage reservoir levels decline. Broomfield is offering free irrigation audits, xeric garden discounts, and rebates for toilets, rain barrels, irrigation controllers and irrigation heads to help residents and businesses achieve long term water efficiency. Please visit www.Broomfield.org/SaveWater to learn more about all of the ways to save money and water in Broomfield.



Drinking Water Contaminant Sources

Drinking water contaminants may occur naturally, or result from human activity. Contaminants may be present in the source water, introduced during the treatment process, or develop after the water leaves the treatment facility.

Source Water. The sources of drinking water (both tap water and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs, and wells. As water travels over the land surface or through the ground, it dissolves naturally-occurring minerals and other contaminants resulting from the presence of plants, animals or from human activity. For example:

- **Microbial contaminants** such as viruses and bacteria may come from sewage treatment plants, septic systems, agriculture, livestock operations, household pets, and wildlife.
- **Inorganic contaminants** such as salts and metals can be naturally-occurring or result from urban stormwater runoff, industrial or domestic wastewater discharges, oil and gas production, mining, or farming.
- **Pesticides and herbicides** may come from sources such as agriculture, urban stormwater runoff, and residential uses.
- **Organic chemical contaminants**, including synthetic and volatile organic chemicals, can be byproducts of industrial processes such as petroleum production, or come from gas stations, urban stormwater runoff, and septic systems.
- **Radioactive contaminants** can be naturally-occurring or result from oil and gas production and mining activities.

Treatment Process. Some regulated substances are introduced during the water treatment process, or as a result of treatment. Examples include fluoride, disinfectants, and disinfection by-products.

After Treatment. After treatment, the interaction of treated water with water mains and household plumbing may contribute other substances, such as lead and copper, to consumers' tap water.



WATER QUALITY DATA

During 2020, Broomfield's Water Treatment staff and Certified Drinking Water Laboratory performed more than 25,000 tests for about 100 different regulated contaminants. The table below lists all the detected regulated drinking water contaminants that Broomfield water consumers could have received during the 2020 calendar year. Contaminants not reported in the table were not detected.

Terms, Abbreviations, and Symbols Used in This Report:

ppm – parts per million, or milligrams per liter (mg/L).
In dollars, 1 ppm = 1 cent in \$10,000

ppb – parts per billion, or micrograms per liter (µg/L).
In dollars, 1 ppb = 1 cent in \$10,000,000

pCi/L – picocuries per liter, a measure of the radioactivity in water.

Maximum Contaminant Level Goal (MCLG) – The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety.

Maximum Contaminant Level (MCL) – The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to the MCLGs as feasible using the best available treatment technology.

Violation – A failure to meet a Colorado Primary Drinking Water Regulation.

Range of Individual Samples – The lowest sample result to the highest sample result.

Average of Individual Samples – The sum of all sample results divided by the number of sample results.

Secondary Maximum Contaminant Level (SMCL) – A non-enforceable, recommended limit for a substance that affects the taste, odor, color or other aesthetic qualities of drinking water, rather than posing a health risk.

Maximum Residual Disinfectant Level (MRDL) – The highest level of a disinfectant allowed in drinking water. There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants.

Maximum Residual Disinfectant Level Goal (MRDLG) – The level of a drinking water disinfectant below which there is no known or expected risk to health. MRDLGs do not reflect the benefits of the use of disinfectants to control microbial contamination.

Treatment Technique (TT) – A required process intended to reduce the level of a contaminant in drinking water.

Turbidity – Turbidity is a measure of the cloudiness of the water. It is measured in "Nephelometric Turbidity Units," or NTU.

Locational Running Annual Average (LRAA) – An average of monitoring results for the previous 12 calendar months at a specific sampling location.

Action Level (AL) – The concentration of a contaminant, which if exceeded, triggers treatment or other requirements a water system must follow.

N/A – Not Applicable **ND** – Not Detected

Minimum Reporting Level (MRL) – The lowest concentration that can be reliably reported using a particular analytical method.

What's the bottom line?

Last year, as in years past, your tap water met or surpassed all EPA and Colorado health standards for drinking water. We're pleased to report that **our system has never violated a Maximum Contaminant Level**. Although some regulated contaminants were detected, the levels were below the health-protection limits established by EPA. .

Other water quality questions?

Our 2020 monitoring results for other water quality characteristics that may be of interest are reported in the table below. These may affect water's taste, smell or appearance. Water hardness may affect how much detergent we use. For more information about water quality concerns or this report, please call Laura Hubbard at **303-464-5606**, or the Water Treatment Plant at **303-464-5600**.

Secondary and Unregulated Water Quality Characteristics

Constituent	Units	Recommended Limit (if any)	Range in Distribution System (Minimum – Maximum)
Secondary Constituents (Recommended Limit is the SMCL)			
Aluminum	ppm	0.05 – 0.2	0.016 – 0.081
Chloride	ppm	250	4.5 – 37
Copper	ppm	1	0.001 – 0.047
Fluoride	ppm	2	0.20 – 0.99
Iron	ppb	300	ND – 260
Manganese	ppb	50	0.43 – 5.3
pH	Std. Units	N/A	7.3 – 10.4
Silver	ppm	0.1	ND – 0.006
Sulfate	ppm	250	15 – 64
Total Dissolved Solids	ppm	500	65 – 240
Zinc	ppm	5	0.001 – 0.007
Unregulated Constituents			
Alkalinity (as CaCO ₃)	ppm	N/A	32 – 100
Hardness (as CaCO ₃)	ppm	< 50 = "soft" >150 = "hard"	26 – 130
	grains per gallon	< 3 = "soft" > 8.8 = "hard"	1.5 – 7.6
Calcium	ppm	N/A	8.2 – 35
Magnesium	ppm	N/A	1.3 – 8.3
Nickel	ppm	0.1	0.001 – 0.003
Potassium	ppm	N/A	0.63 – 1.5
Sodium	ppm	N/A	13 – 27

Treatment Technique (TT) Violation:

In March 2009, Colorado Department of Public Health and the Environment (CDPHE) established minimum values for pH, alkalinity, and silica to reduce lead and copper in Broomfield's drinking water. Between February 19, 2020 and March 18, 2020, the silica levels measured at the WTP were less than the minimum requirement. A clog in the chemical feed line reduced the amount of sodium silicate added by Broomfield and caused the corresponding drop in silica levels. Broomfield upgraded the chemical feed system at the WTP to eliminate future clogging issues, and installed redundant chemical feed pumps to improve overall performance and reliability. Sampling routines, data analysis, and operating procedures have also been modified to identify and respond to potential problems more quickly in the future. The Broomfield WTP returned to compliance for silica levels on March 18, 2020. Other than the reduced silica levels, all other water treatment standards were met during the time frame. The drop in silica levels resulted in a Treatment Technique Violation; Broomfield issued a Tier 2 public notice on June 10, 2020. Since then, the Water Treatment Plant has switched to high pH to inhibit corrosion of lead and copper, and discontinued use of silica. Please read the information below about potential health effects for vulnerable populations. Contact Rick Bednar at **303-464-5602** for more information..

Name	Description	Time Period	Health Effects
Lead and Copper Rule	Water Quality Parameters Level Non-Compliance (LCR)	2/19/20 – 3/18/20	<p>Lead: Infants and children who drink water containing lead in excess of the action level could experience delays in their physical or mental development. Children could show slight deficits in attention span and learning abilities. Adults who drink this water over many years could develop kidney problems or high blood pressure.</p> <p>Copper: Copper is an essential nutrient, but some people who drink water containing copper in excess of the action level over a relatively short amount of time could experience gastrointestinal distress. Some people who drink water containing copper in excess of the action level over many years could suffer liver or kidney damage. People with Wilson's Disease should consult their personal doctor.</p>

DETECTED CONTAMINANTS TABLE: What's in Broomfield's water?

Sampled at the Entry Point to the Distribution System										
Contaminant	Year	CCR Units	EPA Goal (MCLG)	Highest Level Allowed (MCL)	Average	Range of Individual Samples	MCL Violation?	Sample Date/Frequency	Typical Sources	
Arsenic	2020	ppb	2	2	0.21	0.21	No	Annual	Erosion of natural deposits, runoff from orchards; runoff from glass and electronics production waste	
Barium ¹	2020	ppm	2	2	0.032	0.015 – 0.043	No	Monthly	Erosion of natural deposits, discharge of drilling waste	
Chromium	2020	ppb	100	100	0.71	0.71	No	Annual	Erosion of natural deposits, discharge from steel and pulp mills	
Combined Radium	2020	pCi/L	0	5	1.3	1.3	No	Every 6 years	Erosion of natural deposits	
Fluoride	2020	ppm	4	4 (SMCL=2)	0.68	0.68	No	Annual	Water additive to promote strong teeth, erosion of natural deposits, discharge from fertilizer and aluminum factories	
Gross Alpha	2020	pCi/L	0	15	0.3	0.3	No	Every 6 years	Erosion of natural deposits	
Nitrate, as Nitrogen ¹	2020	ppm	10	10	0.02	ND – 0.16	No	Monthly	Runoff from fertilizer use; leaching from septic tanks, sewage; erosion of natural deposits	
Selenium	2020	ppb	50	50	0.55	0.55	No	Annually	Discharge from petroleum and metal refineries; erosion of natural deposits; discharge from mines	
Sodium (monitoring required, but no MCL) ¹	2020	ppm	N/A	N/A	21	6.3 – 35	N/A	Monthly	Naturally present in the environment	
Contaminant	Year	TT Requirement			Results		TT Violation?	Sample Date/Frequency	Typical Sources	
Turbidity ²	2020	Maximum of 1 NTU for any single measurement			Highest single measurement: 0.23 NTU		No	January, every 4 hours	Soil runoff	
	2020	Each month, at least 95% of samples must be less than 0.3 NTU			Lowest % of samples less than 0.3 NTU: 100%		No	Every 4 hours		
Sampled at the Treatment Facility										
Disinfection Byproduct Precursor	Year	Unit of Measure	TT Minimum Ratio		Average	Range of Individual Ratio Samples	TT Violation?	Number of Samples	Typical Sources	
Total Organic Carbon Ratio	2020	Ratio	1		1.28	0.94 – 1.61	No	12	Naturally present in the environment	
Sampled in the Distribution System ³										
Disinfection Byproduct	Year	CCR Units	MCLG	MCL	Highest Compliance Value (LRAA)	Range of Compliance Values (LRAA)	Range of Individual Samples	MCL Violation?	Number of Samples	Typical Sources
Total Trihalomethanes (TTHM)	2020	ppb	0	80	26.7	20.1 – 26.7	12.1 – 34.0	No	32	Byproducts of chlorine disinfection of drinking water
Haloacetic acids (HAA5)	2020	ppb	0	60	17.9	12.5 – 17.9	8.3 – 23.4	No	32	
Disinfectant	Year	CCR Units	EPA Goal (MRDLG)	Highest Level Allowed (MRDL)	Average	Range of Individual Samples	MRDL Violation?	Sample Date/Frequency	Typical Sources	
Total Chlorine (chloramine)	2020	ppm	4	4.0	2.3	0.22 – 3.4	No	110 per month	Water additive used to control microbes	
Disinfectant	Year	TT Requirement		Results		Number of Samples Below Level	TT Violation?	Sample Date/Frequency	Typical Sources	
Total Chlorine (chloramine)	2020	At least 95% of samples each month must be at least 0.2 ppm.		Lowest monthly percentage of samples meeting TT Requirement: 100%		0	No	110 samples per month	Water additive used to control microbes	
Sampled at the Consumer's Tap										
Residential lead and copper monitoring is now required every 6 months due to a recent treatment change.	2020	CCR Units	Action Level (AL) ⁴	90th Percentile	Sample Sites Above AL	Number of Samples	MCL Violation?	Sample Date/Frequency	Typical Sources	
Lead	1st Half	ppb	15	2.5	2	78	No	May - June/ Every 6 months	Corrosion of household plumbing; erosion of natural deposits	
Copper	1st Half	ppm	1.3	0.03	Zero	78	No			
Lead	2nd Half	ppb	15	2.4	Zero	109	No	July - Oct./ Every 6 months		
Copper	2nd Half	ppm	1.3	0.03	Zero	109	No			

¹ Denver Water data. We report the maximum detected concentration that Broomfield water customers could have received, from either Broomfield or Denver Water sources.

² Turbidity has no health effects. However, turbidity can interfere with disinfection and provide a medium for microbial growth.

³ TTHM and HAA5 are regulated as a locational running annual average (LRAA), not a single value.

⁴ The Action Levels for lead and copper apply to the 90th percentile of all samples collected; 90% of the sample results must be below the Action Level.